
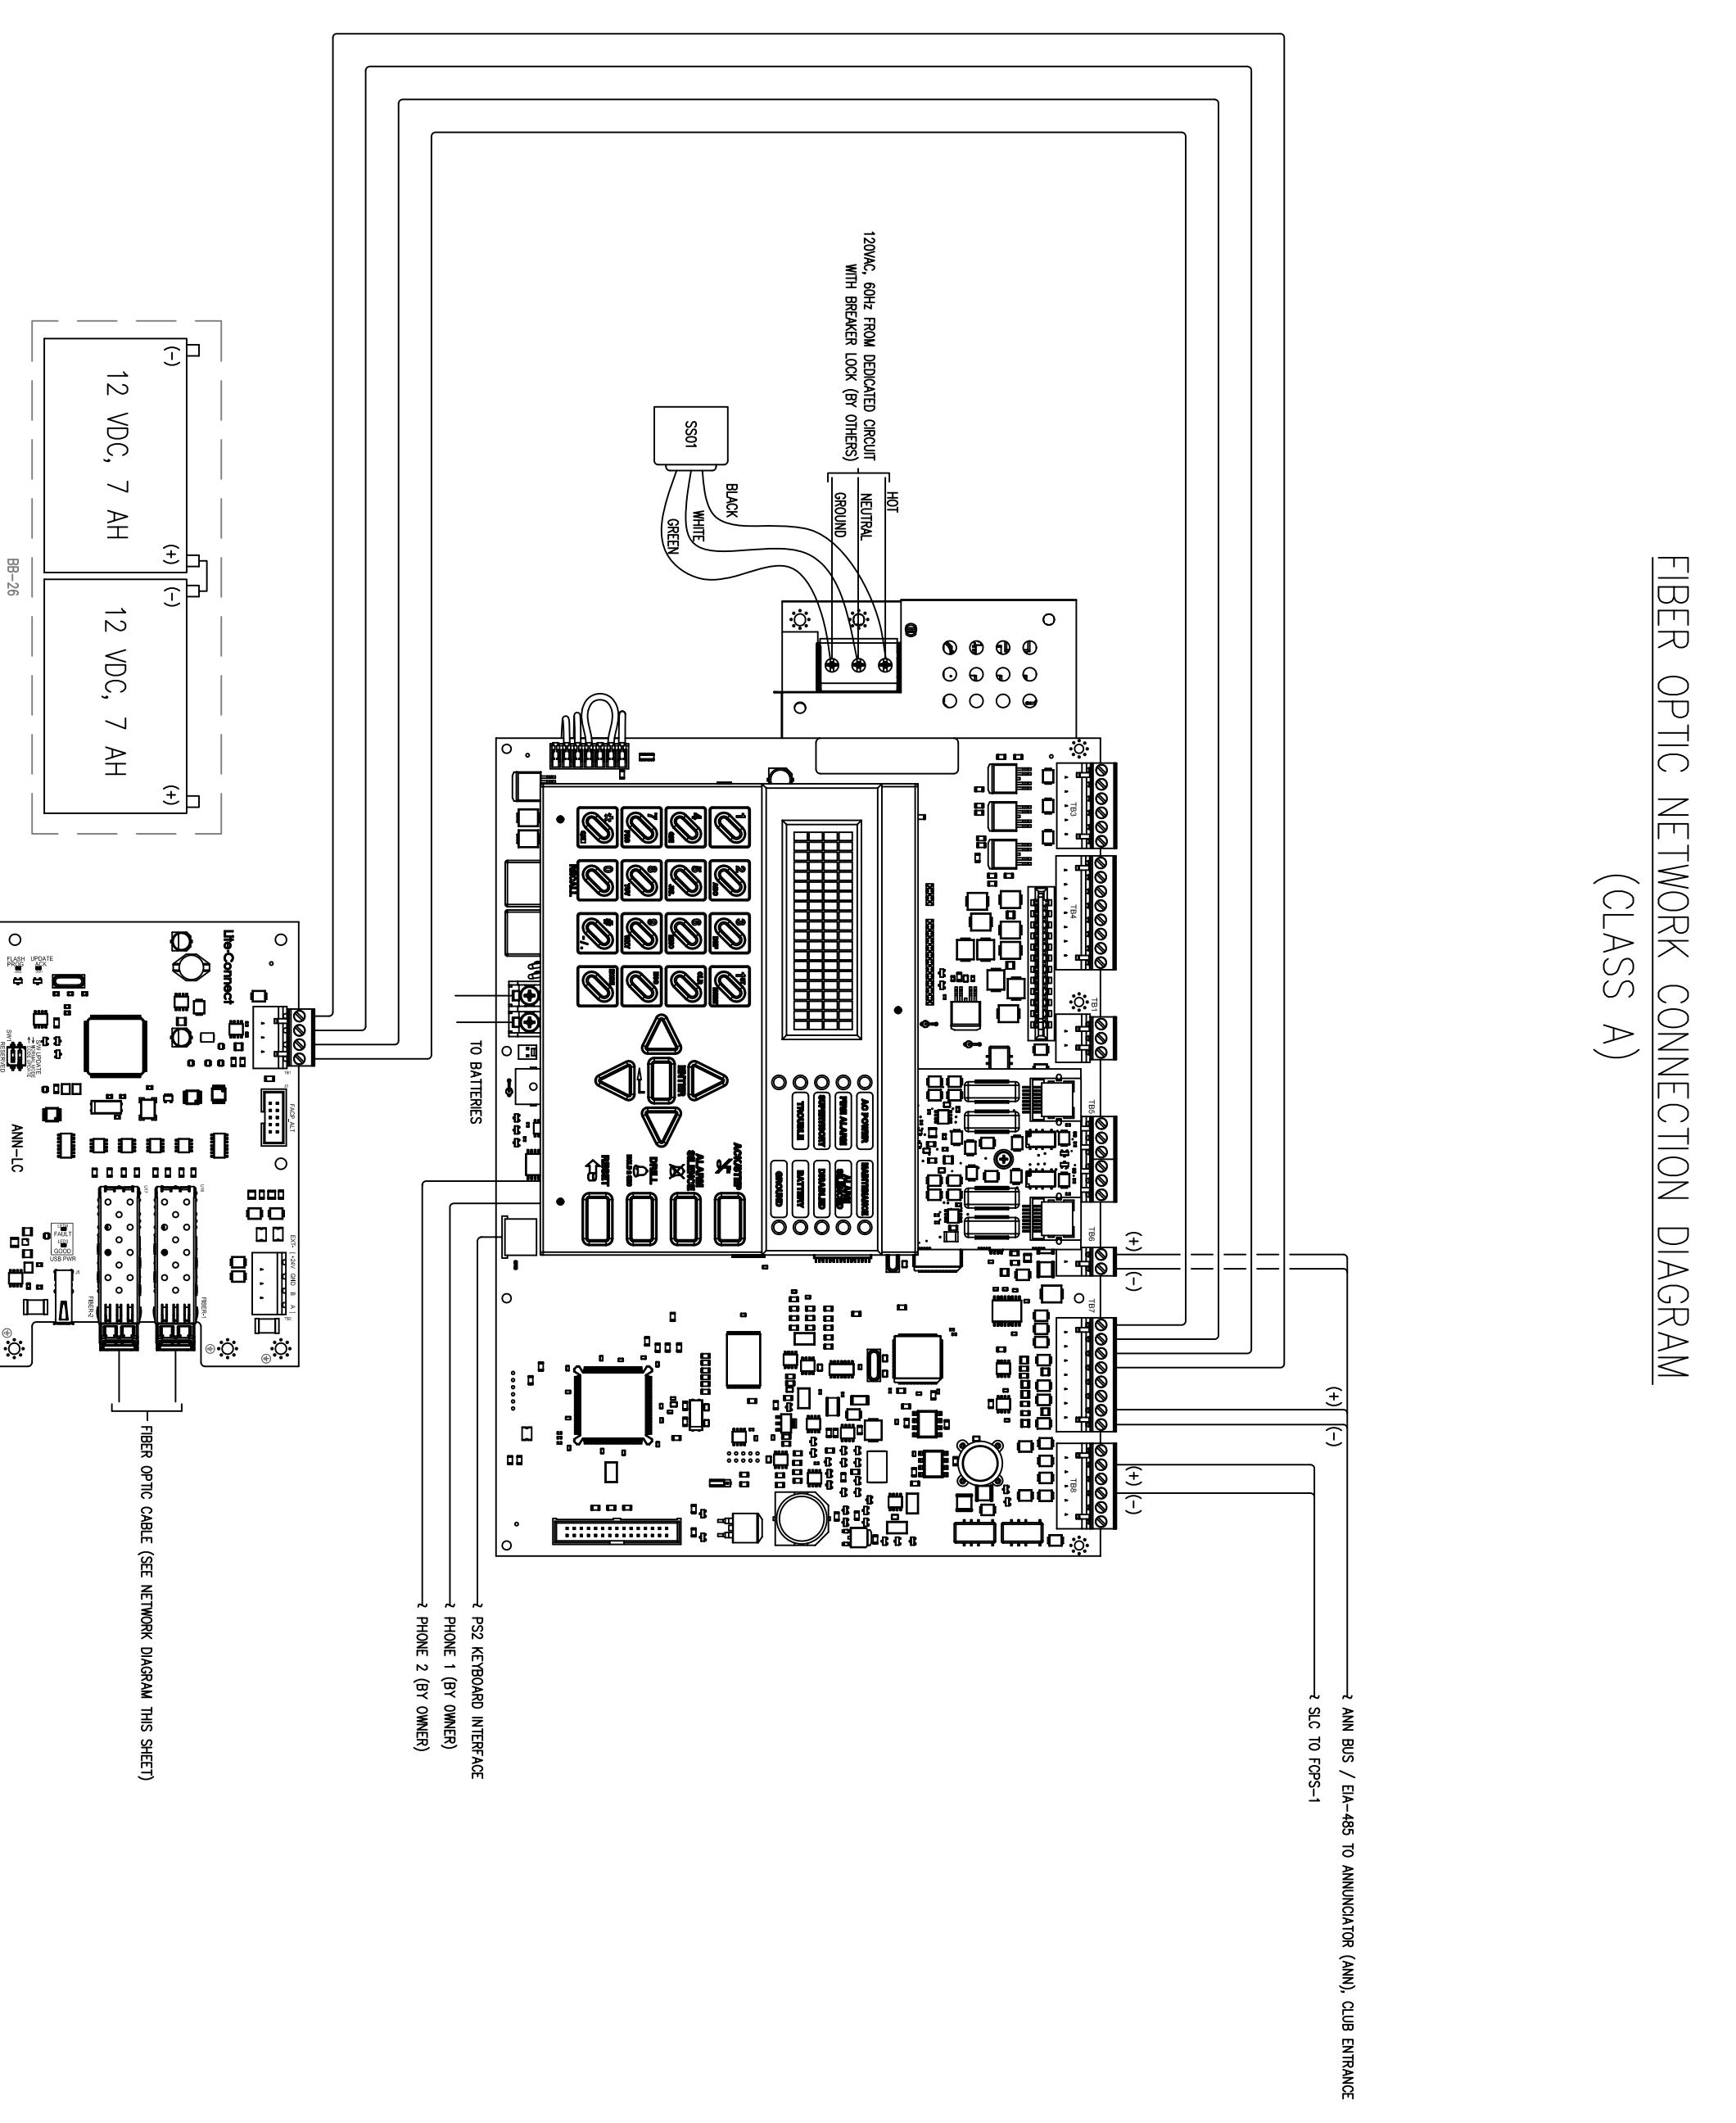


BILL OF MATERIAL

ITEM	DESCRIPTION	MANUFACTURER	QTY	NOTES
①	ENCLOSURE 16.65"Wx19"Hx5.21"D	FIRELITE	1	
②	DOOR	FIRELITE	1	
③	GPU, MS-9200 WITH XRM-248	FIRELITE	1	
④	ANN-LC	POWERSONIC	2	
⑤	BATTERY, 12 VDC, 7 AH	DITEK	1	
-	SURGE SUPPRESSOR (OTK-120HW)		1	

ENCLOSURE DETAILS (BB-26)
3"=1'-0"

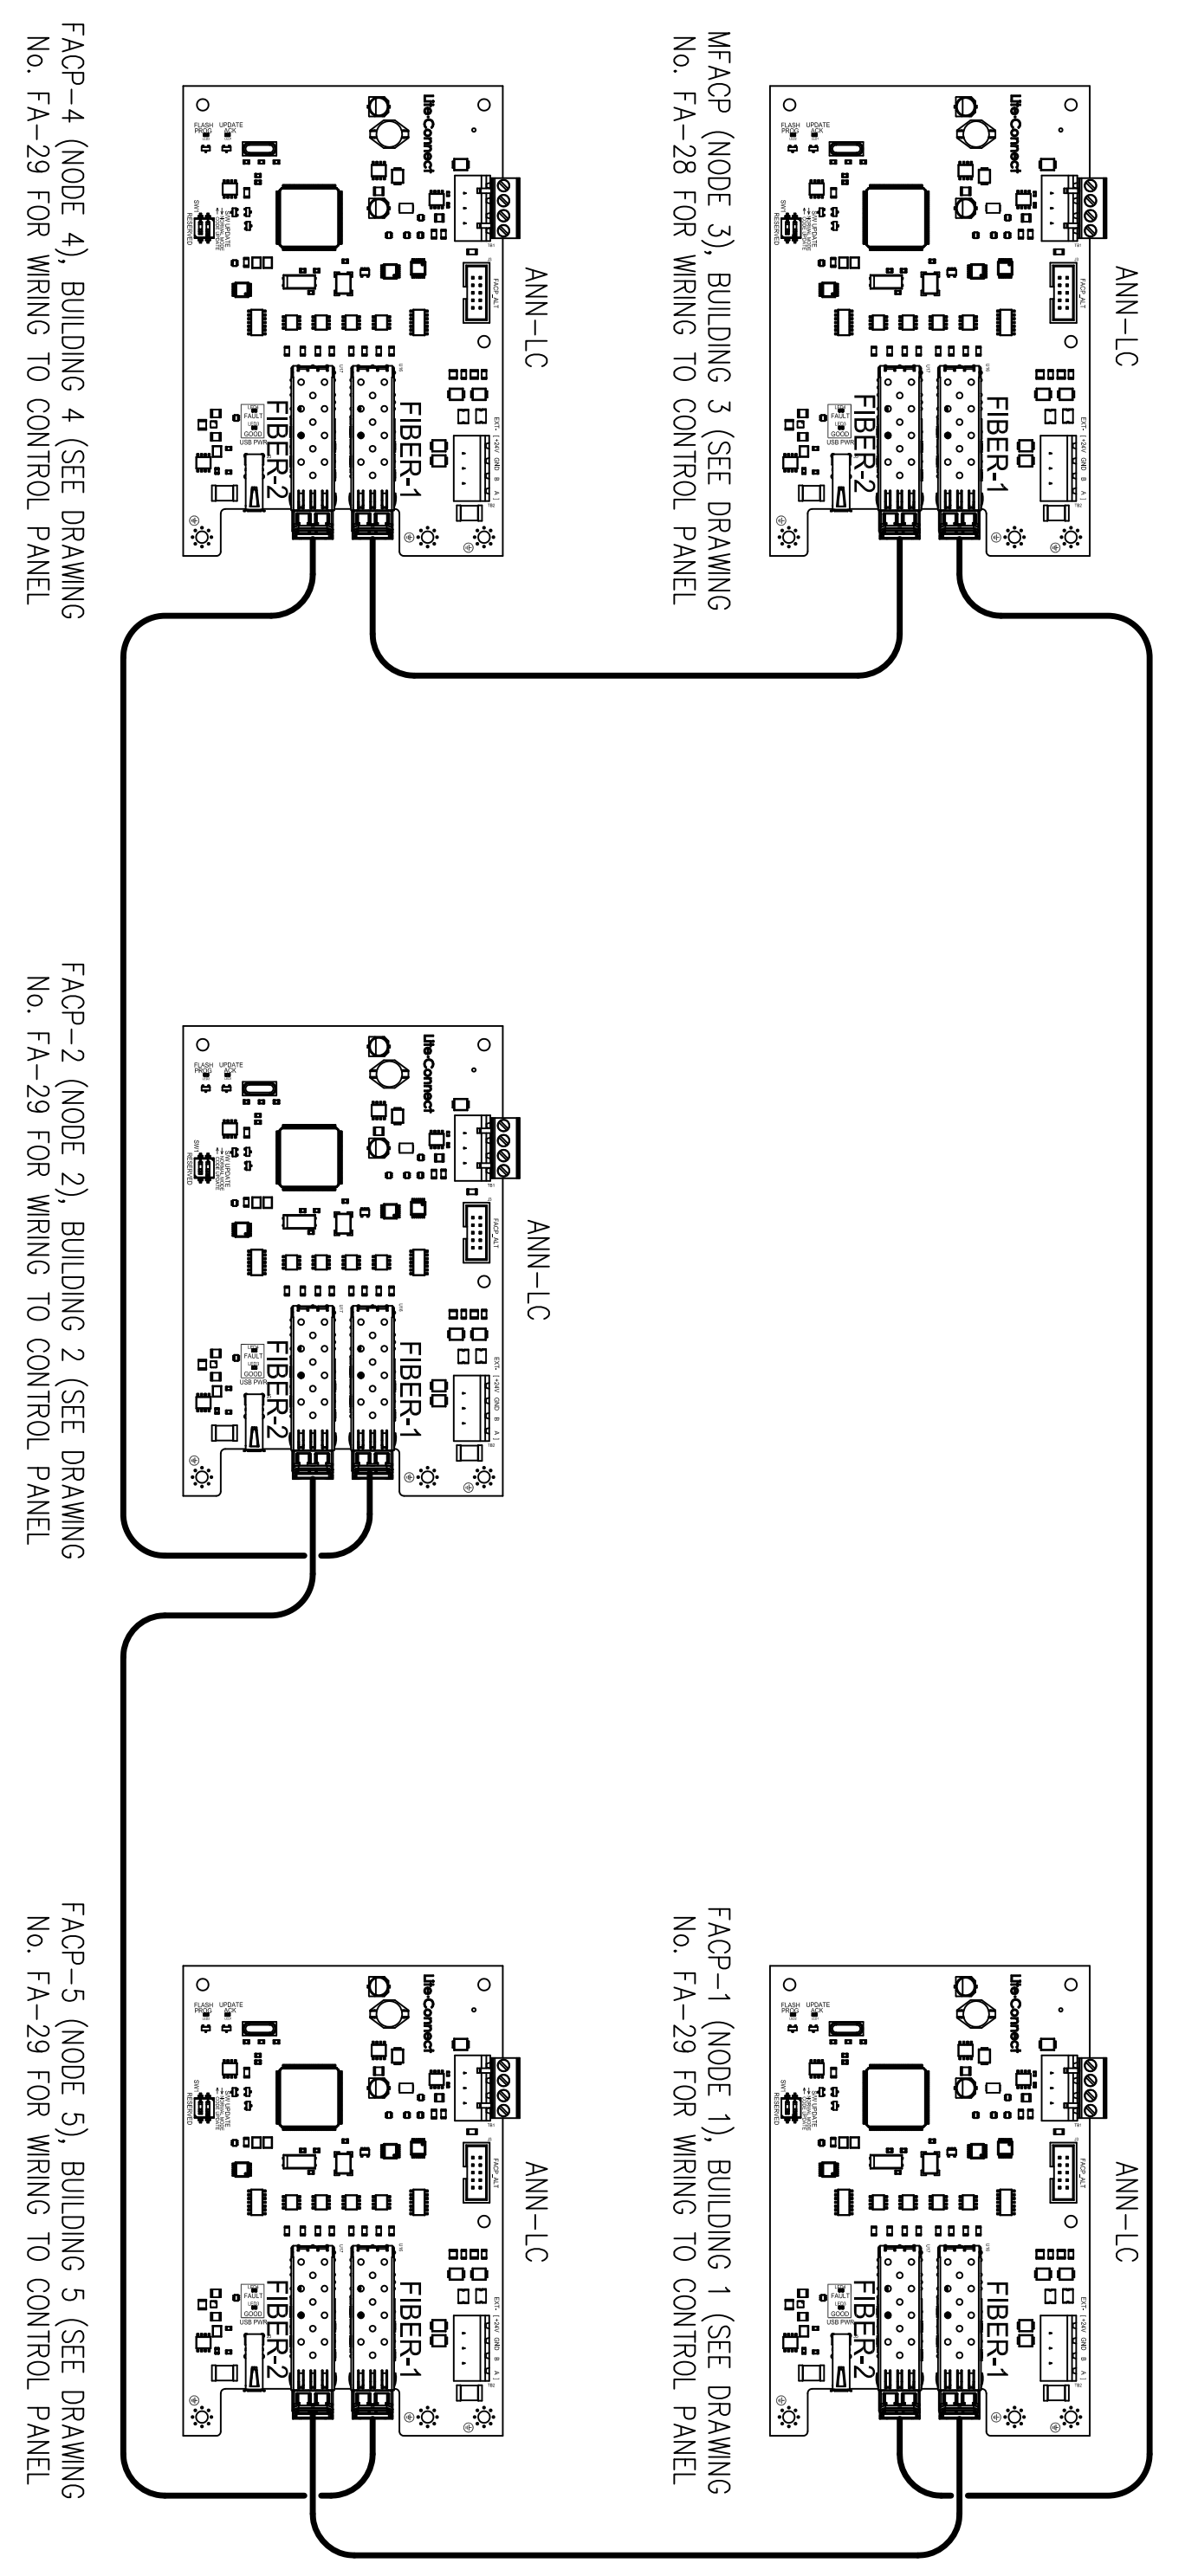

GENERAL NOTES

- SEE DRAWING No. FA-1 FOR GENERAL NOTES, SYMBOL LEGEND AND CABLE TAG IDENTIFICATION.
- SEE DRAWING No. FA-25 RISER DIAGRAM AND INPUT/OUTPUT MATRIX.
- FIRE ALARM CONTROL PANEL (FACP) POWERED FROM 120VAC, 60Hz, DEDICATED CIRCUIT WITH BREAKER LOCK LABELLED "FIRE ALARM CIRCUIT".
- MULTI-MODE FIBER-OPTIC CABLES MUST BE USED. CONNECTIONS MUST BE MADE USING DUPLEX LC CONNECTORS (PER IEC 61754-20). THE OVER-BENDING OF FIBER-OPTIC CABLES CAN CAUSE BREAKAGE. CONSULT MANUFACTURER'S GUIDELINES FOR MINIMUM RADIUS OF BEND FOR FIBER-OPTIC MEDIA.

REVISIONS

REVISION	DESCRIPTION	BY:	CHK:	DATE
0	ORIGINAL ISSUE	PJ	JB	3/20/15

PROJECT LOCATION:

VAS APARTMENTS, LLC
VILLAGE CLUB AT SANDHILL APARTMENTS
COLUMBIA, SOUTH CAROLINA 29229

DRAWN

ISSUE DATE: 3/20/2015
DESIGNED: *Shad G. Stephens*
PROJECT No.: SBT-007
APPROVED: *Shad G. Stephens*
SCALE: NONE

DRAWING TITLE:

MAIN FIRE ALARM CONTROL PANEL (MFACP),
FIBER NETWORK, ENCLOSURE DETAILS, AND
INTERNAL WIRING DIAGRAM

DRAWING NO.:

FA-28

SIZE:

ARCH D

REVISION:

0

ISSUE DATE:

STEEL-BAR TECHNOLOGY
2839 GRAY FOX ROAD
MONROE, NORTH CAROLINA 28079
(704) 680-7595